


# Locating The Serial Numbers On Your New Products

Contact your installing dealer or  
print this document for help  
Call us for assistance at: 1-877-472-4447.

# Which New Products Do You Have?

- Packaged Unit (All in One)



- Thermostat



- Air Conditioner or Heat Pump



- Air Cleaner



- Furnace




- Humidifier



- Indoor Coil



- Energy Recovery Ventilator




- Air Handler



# Packaged Unit


- The serial number label is located on the rear panel of the outdoor unit.

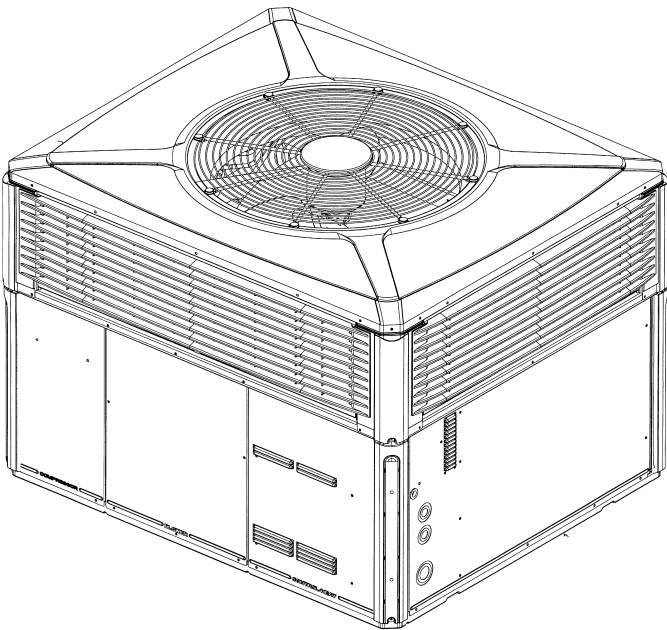

TRANE	
Fort Smith, AR. 72903	
MODEL NO.	FORCED AIR FURNACE WITH COOLING UNIT, FOR OUTDOOR INSTALLATION ONLY.
SERIAL NO.	
DATE OF MFG.	
ELECTRICAL RATING	
MIN/MAX OPER. VOLT	/
MAX HACR CKT BRK	
MAX CKT BRK(CANADIAN INST)	INSTALL AND MAINTAIN THIS UNIT AS DESCRIBED IN THE MANUALS PROVIDED.
CONTROL CKT VOLT	
MIN CKT AMP	
MAX FUSE SIZE	
MIN TEST PRESSURE: HIGH	LOW PSIG
BR. CKT. SEL. CUR.	
COMPR QTY PH HZ RLA LRA	ANSI Z21.47b-USA 2.3b-2008 CENTRAL FURNACE
A	
B	
INTERNALLY PROTECTED COMPRESSOR	
FAN QTY PH HZ FLA HP	QTY REFRIG CKTS
COND	FACTORY CHARGED:
EVAP	LBS - OZ
EXHAUST	CPR "A" R22
	CPR "B" R22
HEATING INPUT BTUH	
HEATING OUTPUT BTUH	
MIN. INPUT BTUH	
ORIFICE DRILL SIZE	
ALTITUDE SPECIFICATIONS	0-2000 FT
MAX EXT S.P. INCHES W.C.	
TEMP RISE	DEG F
DESIGNED MAX OUTLET AIR TEMP.	DEG F
MAX GAS SUPPLY PRESS IN. W.C.	FOR GAS
MIN GAS SUPPLY PRESS IN. W.C.	MIN AMBIENT TEMP
MANIFOLD PRESS INCHES W.C.	
WHEN UNIT IS CONVERTED TO DOWNFLOW, METAL OR CLASS 1 PLENUM AND AIR OUTLET DUCT MUST BE USED	
CLEARANCES TO COMBUSTIBLE MATERIAL (INCHES): TOP	
L. SIDE	R. SIDE
FRONT	BACK
FOR INSTALLATION ON COMBUSTIBLE FLOORING OR CLASS A,B,C ROOF COVERING MATERIAL.	
Manufactured under one or more of the following U.S. Patents	
ASSEMBLED IN USA	
D932287P01	
ME A B	
UL LISTED	
D672473P02	
LISTED MODELS	

# Air Conditioner or Heat Pump


- The serial number label is located on the top, right-rear of the outdoor unit.

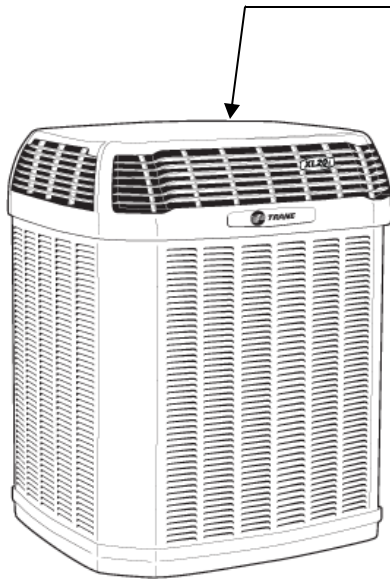

MOD. NO.		MFR. DATE	
SERIAL NO.		VOLTS	
MINIMUM CIRCUIT CAPACITY		HZ	
OVERCURRENT PROTECTIVE DEVICE		AMPS	
MIN FUSE / BREAKER (HACR)		USA CANADA	
MAX FUSE / BREAKER (HACR)			
LBS. OZ. OR		kg (SI)	
AMERICAN STANDARD INC. AND AMERICAN STANDARD			
TYLER, TX 75707 ASSEMBLED IN USA 3059934 OUTDOOR USE			
COMPR. MOT.	RLA	V	LRA
O.D. MOT.	FLA	V	HP
M.E.A. NO.	F. ID.		
ENERGY STAR		ARI PERFORMANCE CERTIFIED	
		ARI Standard 210/240 U	
		CERTIFICATION APPLIES ONLY WHEN THE COMPLETE SYSTEM IS LISTED WITH ARI	

# Furnace


- The serial number label is located on the right or left panel of the furnace. (closet, attic, basement, garage)

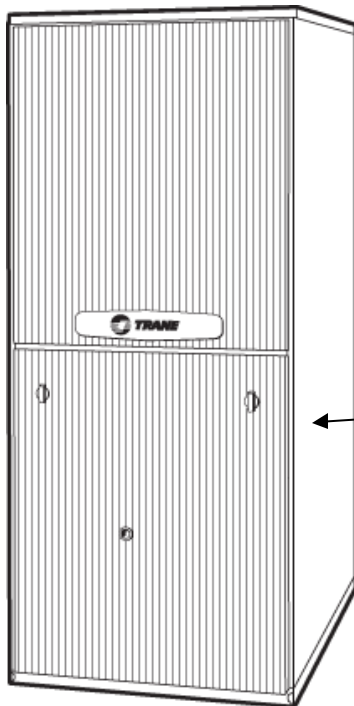


MODEL NUMBER:	NUMERO DE MODELE:
SERIAL NUMBER:	NUMERO DE SERIE:
DATE OF MANUFACTURE:	MM/YY


# Indoor Coil

- The serial number label is located on the front panel of the indoor coil unit. (with the furnace)

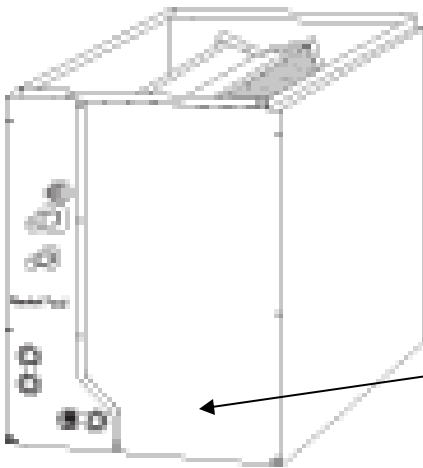

(A)		
		Assembled in USA
MODEL NO.	SERIAL NO.	
SUITABLE FOR MOBILE HOME USE		
REFRIGERANT	MFG DATE	DESIGN PSI
B340527P01		


- The serial number label is located on the front panel of the indoor unit. (closet, attic, basement, garage)

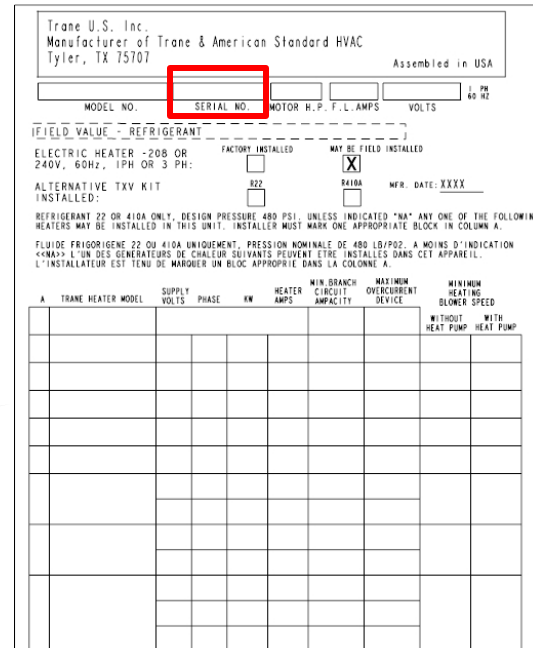

**VORTICA™** airflow system, **AIR-TITE** cabinet construction.

# Thermostat

- The model number label is located behind the front cover. (Remove from wall plate)

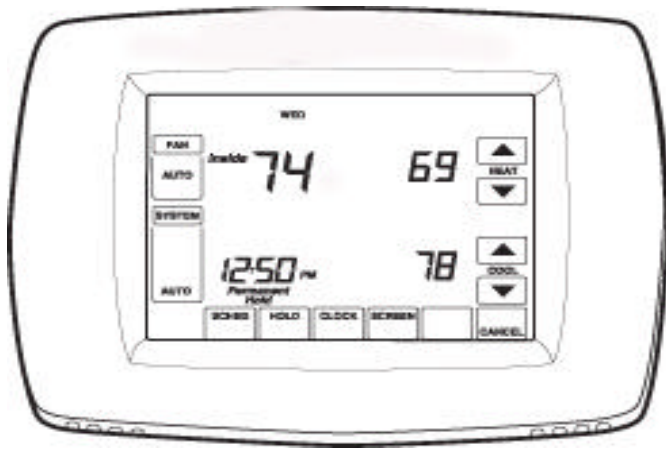

Assembled in Mexico

**TCONT803A832DAA**

0750


TH832U1030



US Patent #: 6595430, D509151,  
Additional patents pending



# Air Cleaner

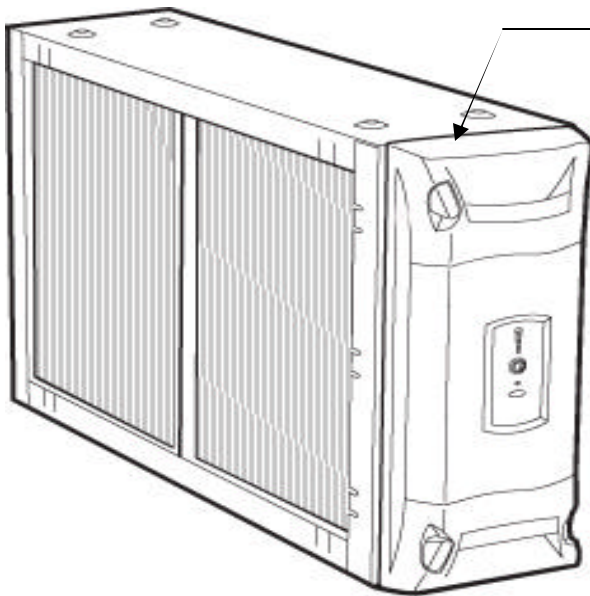
- The serial number label is located on the back of the door. (Next to furnace or air handler)



Trane U.S. Inc. Manufacturer of Trane & American Standard HVAC Tyler, TX 75707		ELECTROSTATIC AIR CLEANER	
MODEL NO.			
SERIAL NO.			
MFG. DATE			
24 VAC 0.8 AMPS			
D802464		ELECTROSTATIC AIR CLEANER 29VD	
MANUFACTURED UNDER ONE OR MORE OF THE FOLLOWING U.S. PATENTS: 6,749,669, 7,332,019, 7,351,274 AND D540,930 EPA Est.No.084781-GA-001			

# Humidifier

- The serial number label is located on the bottom of the unit. (near furnace or air handler)

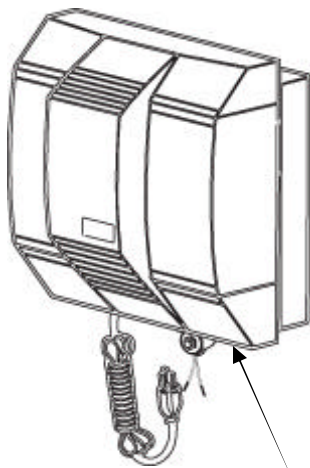

Model Number


**THUMD500APA00BA**



Serial Number

\_\_\_\_\_

# Energy Recovery Ventilator

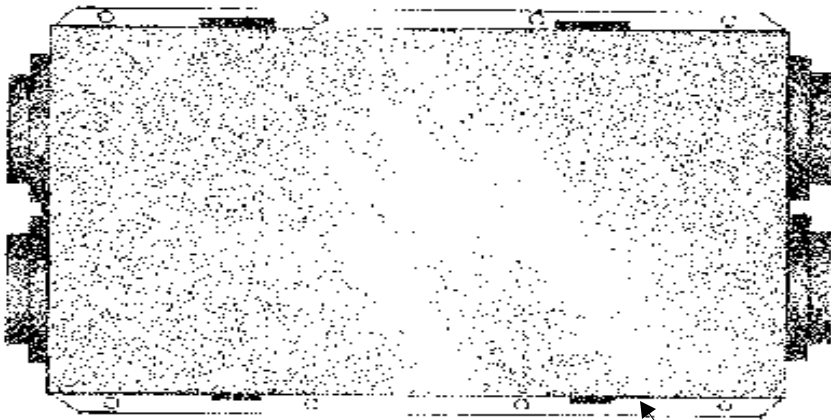- The serial number label is located on the bottom of the unit. (near external wall in attic, basement, garage)



 LISTED 440315 1600 600440120 KCC	<b>Energy Recovery Ventilator</b>		
898S	MODEL ERV100A9P00AA	MODELE	
DUCTED HEAT RECOVERY VENTILATOR			
For residential use only. Not for use in cooking area. WARNING: Danger of electrical shock. Always disconnect from power source before servicing.		Pour residence seulement. Ne pas utiliser dans les aires de emission. AVERTISSEMENT: Danger de choc electrique. Toujours deconnecter la source d'alimentation avant les reparations.	
120V, 50HZ, 1 Phase Qty 1: .09 HP & 1.2 F.L.A. Motors Thermally Protected		120V, 50HZ, 1 Phasee Qty 1: de chaque .09 CV & 1.2 A.P.C. Moteurs proteges thermiquement	
<b>SERIAL NUMBER:</b>		Trane 6200 Troup Highway Tyler, TX 75707	